




DUCTWORK				
A	B	C	D	QTY.
8"	8"	12"	1"	1

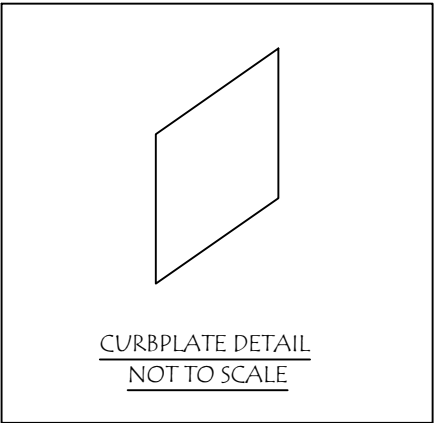


CURBPLATE		
WIDTH	LENG.	QTY.
13"	13"	1

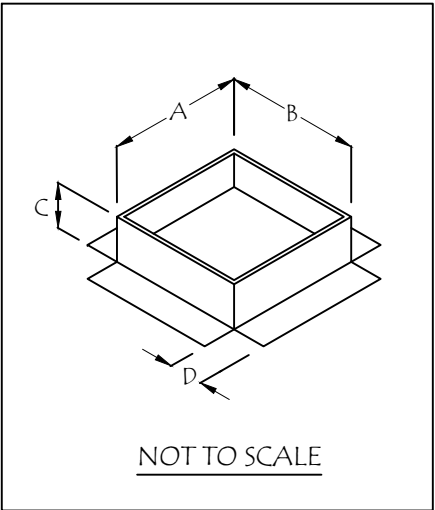


FAN MODEL	A	B	C	D
10D	12"	12"	2"	4"

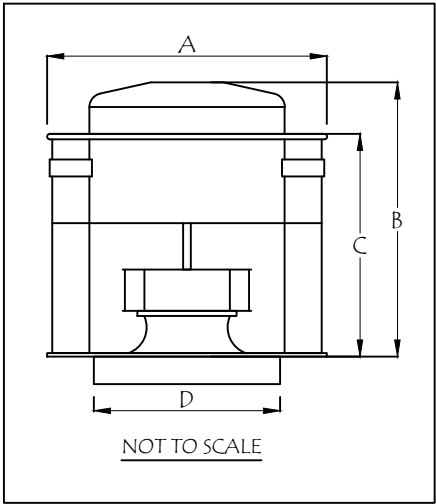


FAN MODEL	A	B	C	D	WT. LBS.
10D	20 1/4"	16 1/4"	12 1/2"	13 1/2" SQ.	43 LBS.

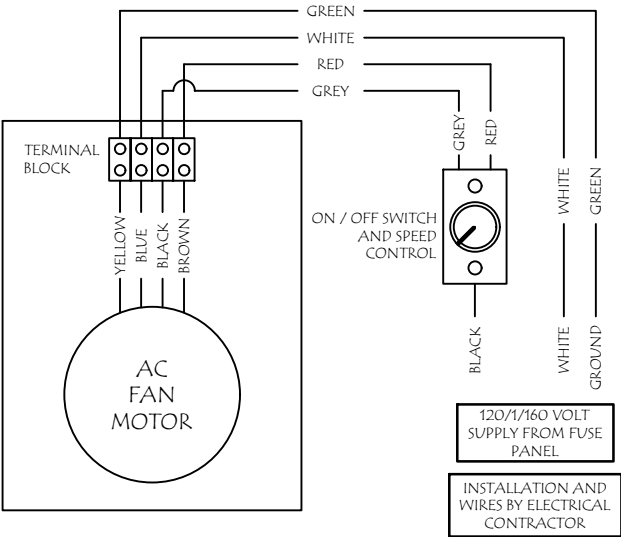

VARIABLE SPEED CONTROL DIAGRAM
NOT TO SCALE

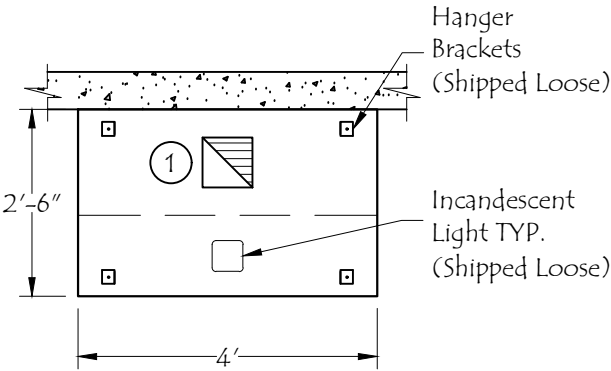

PLAN VIEW
SCALE: 3/8"=1'-0"

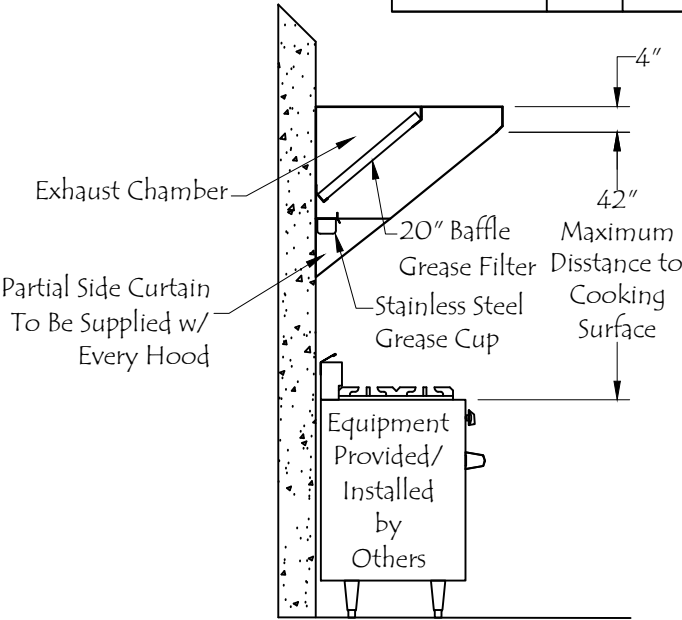

SIDE VIEW
SCALE: 3/8"=1'-0"

*IT IS THE RESPONSIBILITY OF THE ARCHITECT/OWNER TO ENSURE THAT THE HOOD CLEARANCE FROM LIMITED-COMBUSTIBLE MATERIALS IS IN COMPLIANCE WITH LOCAL CODE REQUIREMENTS




ALL EQUIPMENT IS UL LISTED COMPONENTS

HOODMART HOODS ARE BUILT IN COMPLIANCE WITH :
NFPA #96 & UL710

AND ARE RECOGNIZED BY ONE OR MORE OF THE FOLLOWING:
- NSF INTERNATIONAL -UL

HOOD NO.	MODEL	LENGTH	MAX. COOKING TEMP.	① EXHAUST PLENUM					② SUPPLY PLENUM					HOOD CONSTRUCTION		
				TOTAL EXH. CFM	RISER(S)				TOTAL SUP. CFM	RISER(S)						
					WIDTH	LENG.	QTY.	CFM		S.P.	WIDTH	LENG.	QTY..	CFM	S.P.	
1	EXSS004C 4X30	48"NOM 48"OD	700 Deg.	800	8"	8"	1	800	.375"	-	-	-	-	-	-	STAINLESS STEEL

HOOD NO.	FILTER(S)				LIGHT(S)			UTILITY CABINET(S)							EST. HOOD WEIGHT					
	TYPE	QTY.	HEIGHT	LENGTH	TYPE	QTY.	WIRE GUARD	FIRE SYSTEM		ELECTRICAL MODEL #	SWITCHES									
								TYPE	SIZE		QUANTITY	LOCATION								
1	S.S. BAFFLE W/ HANDLES	3	20"	16"	INCANDESCENT LIGHT	1	NO	--	--	--	--	--	140 LBS.							
		0	20"	20"																
FAN UNIT NO.	FAN UNIT MODEL #	EXHAUST FAN									SUPPLY FAN									
		MODEL	TAG	CFM	S.P.	RPM	H.P.	Ø	VOLT	FLA	BLOWER	HOUSING	TAG	CFM	S.P.	RPM	H.P.	Ø	VOLT	FLA
1	10D EF-1	10D	EF-1	800	.375"	1550	1/10	1	115	3.0										
2																				



REVISIONS

REV	DATE	DRWN BY	APP'D BY	REMARKS
-	-	-	-	-

172 REASER COURT
ELYRIA, OHIO 44035

TOLL FREE : 1-800-715-1014
FAX: 1-800-716-1214

EQUIPMENT SCHEDULE

CONCESSION CANOPY

CONTRACT NO. - ITEM NO. -

JOB: -
LOC: -
CUST: -
CUST#: -

DATE -
DRAWN BY -

SCALE AS NOTED
APPROVED BY -

DWG# -11901

SHT -
OF -